
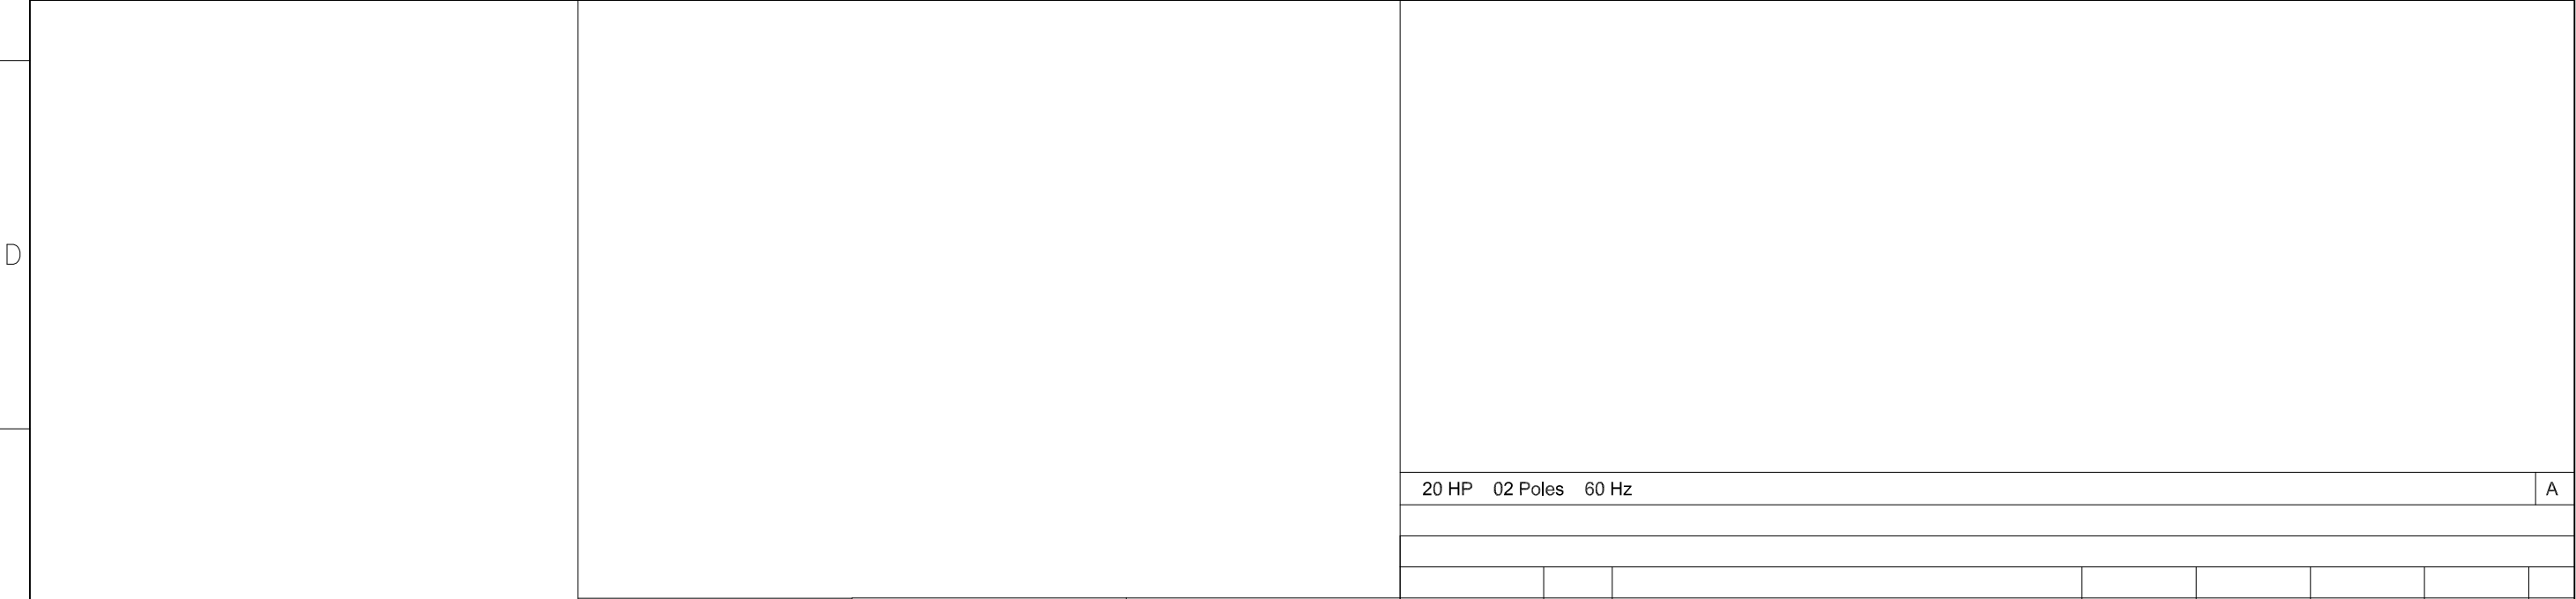


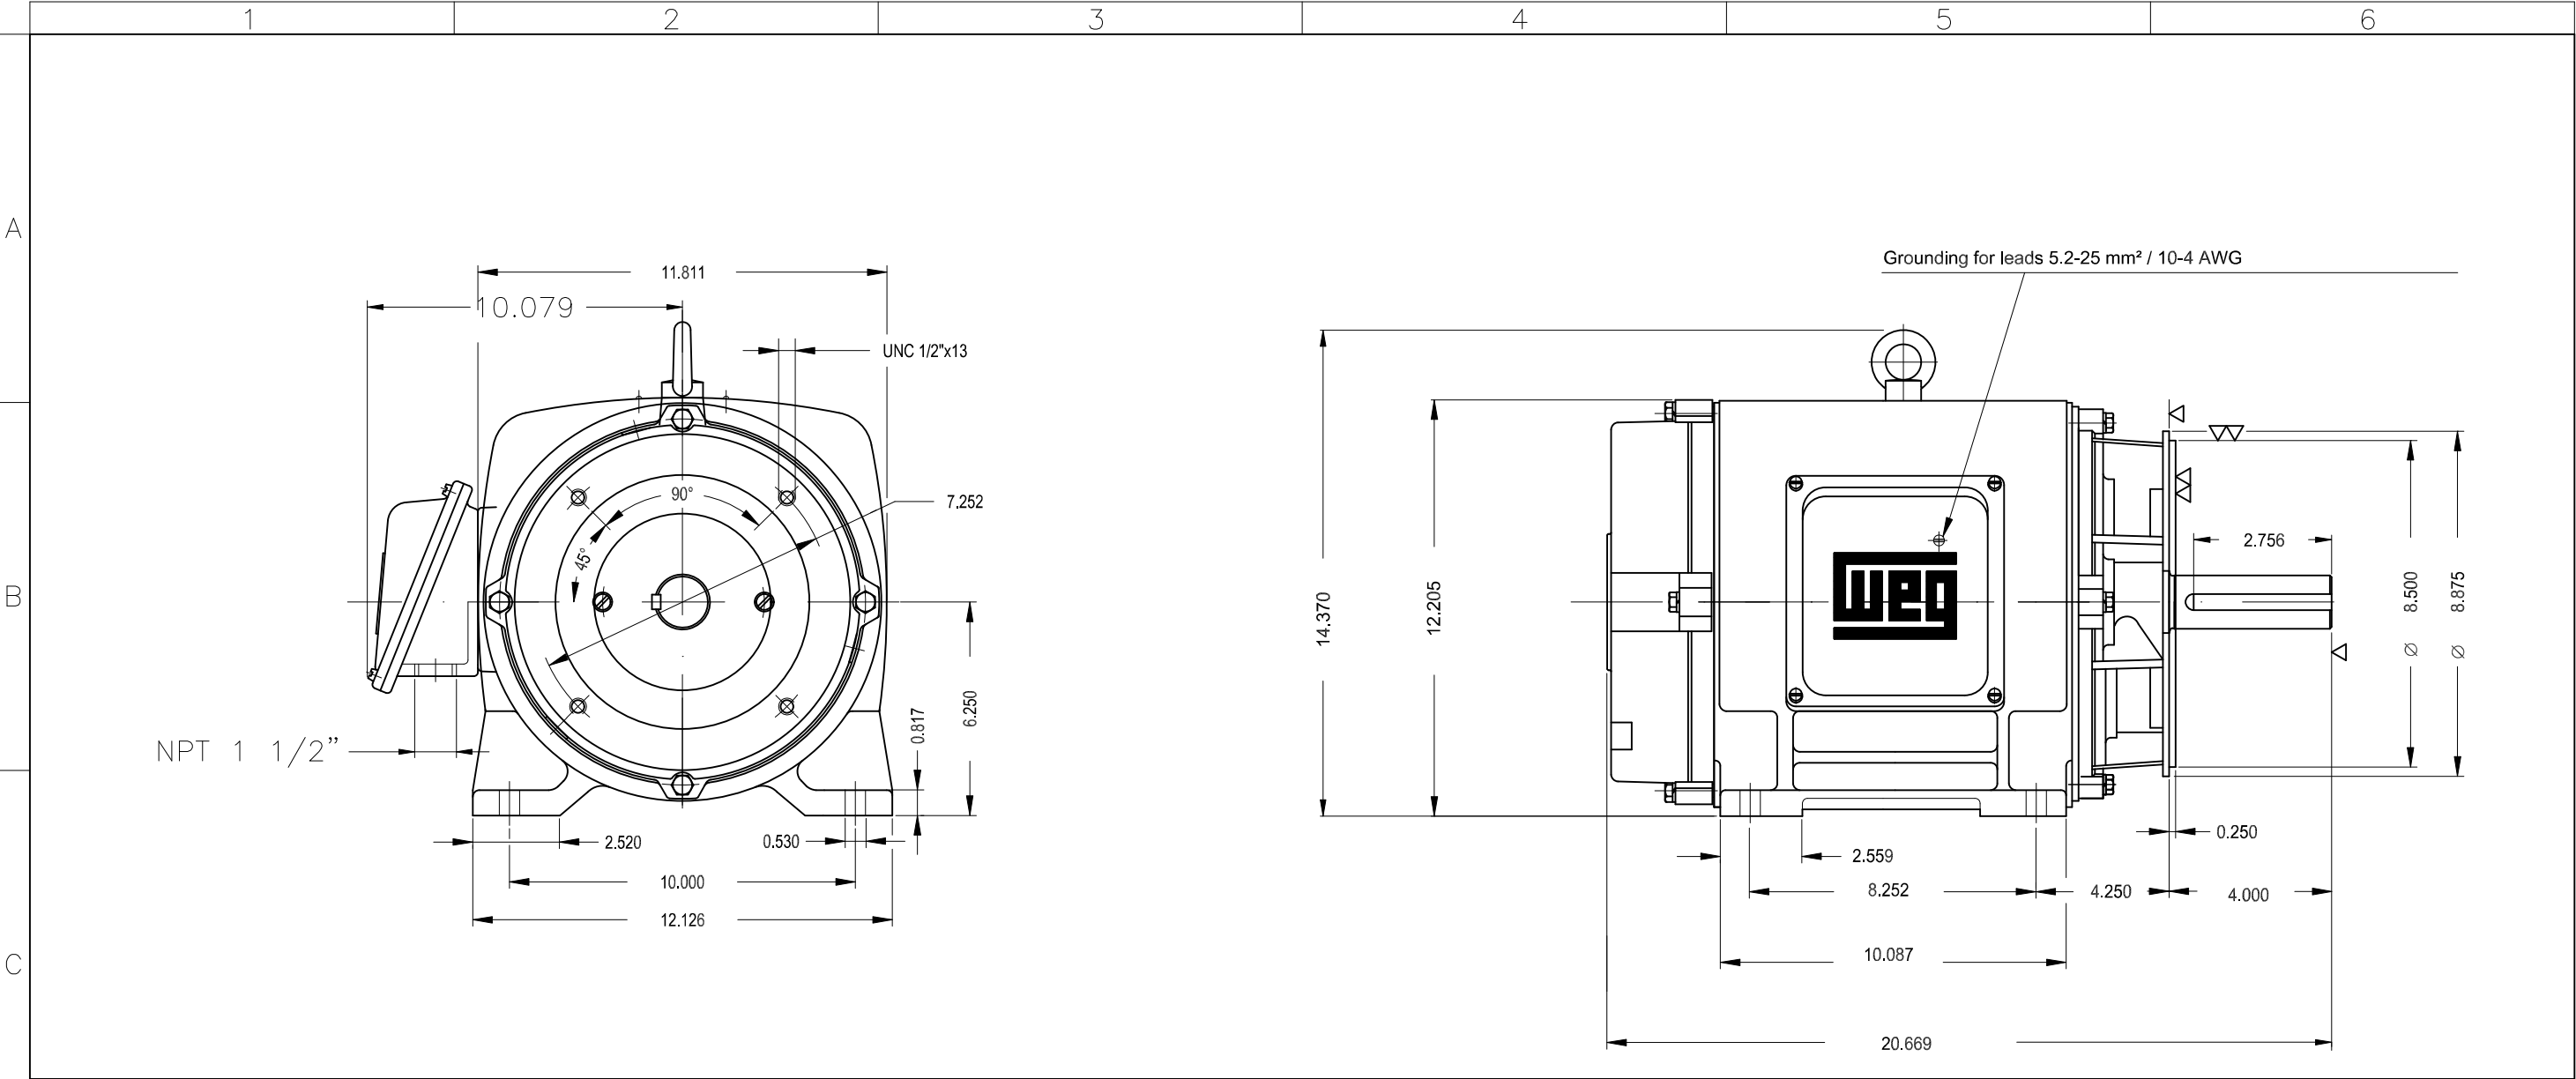

Certification UL/FIRE PUMP		Color RAL 5009		Painting plan 203A		Mounting NEMA F-1		Mounting B34D	
20 HP		02 Poles		60 Hz		HYBRISUSER		00	
ECM		LOC		SUMMARY OF MODIFICATIONS		EXECUTED		CHECKED	
EXECUTED		HYBRISUSER		THREE PH. MOTOR GENERAL HIGH EFF.		WDD		00	
CHECKED				FRAME 254TC IP23 ODP		REL. DATE		WMO Jaragua do Sul	
RELEASED						Product Engineering		SHEET 1 / 1	
PREVIEW		WDD		00		XME		A3	