



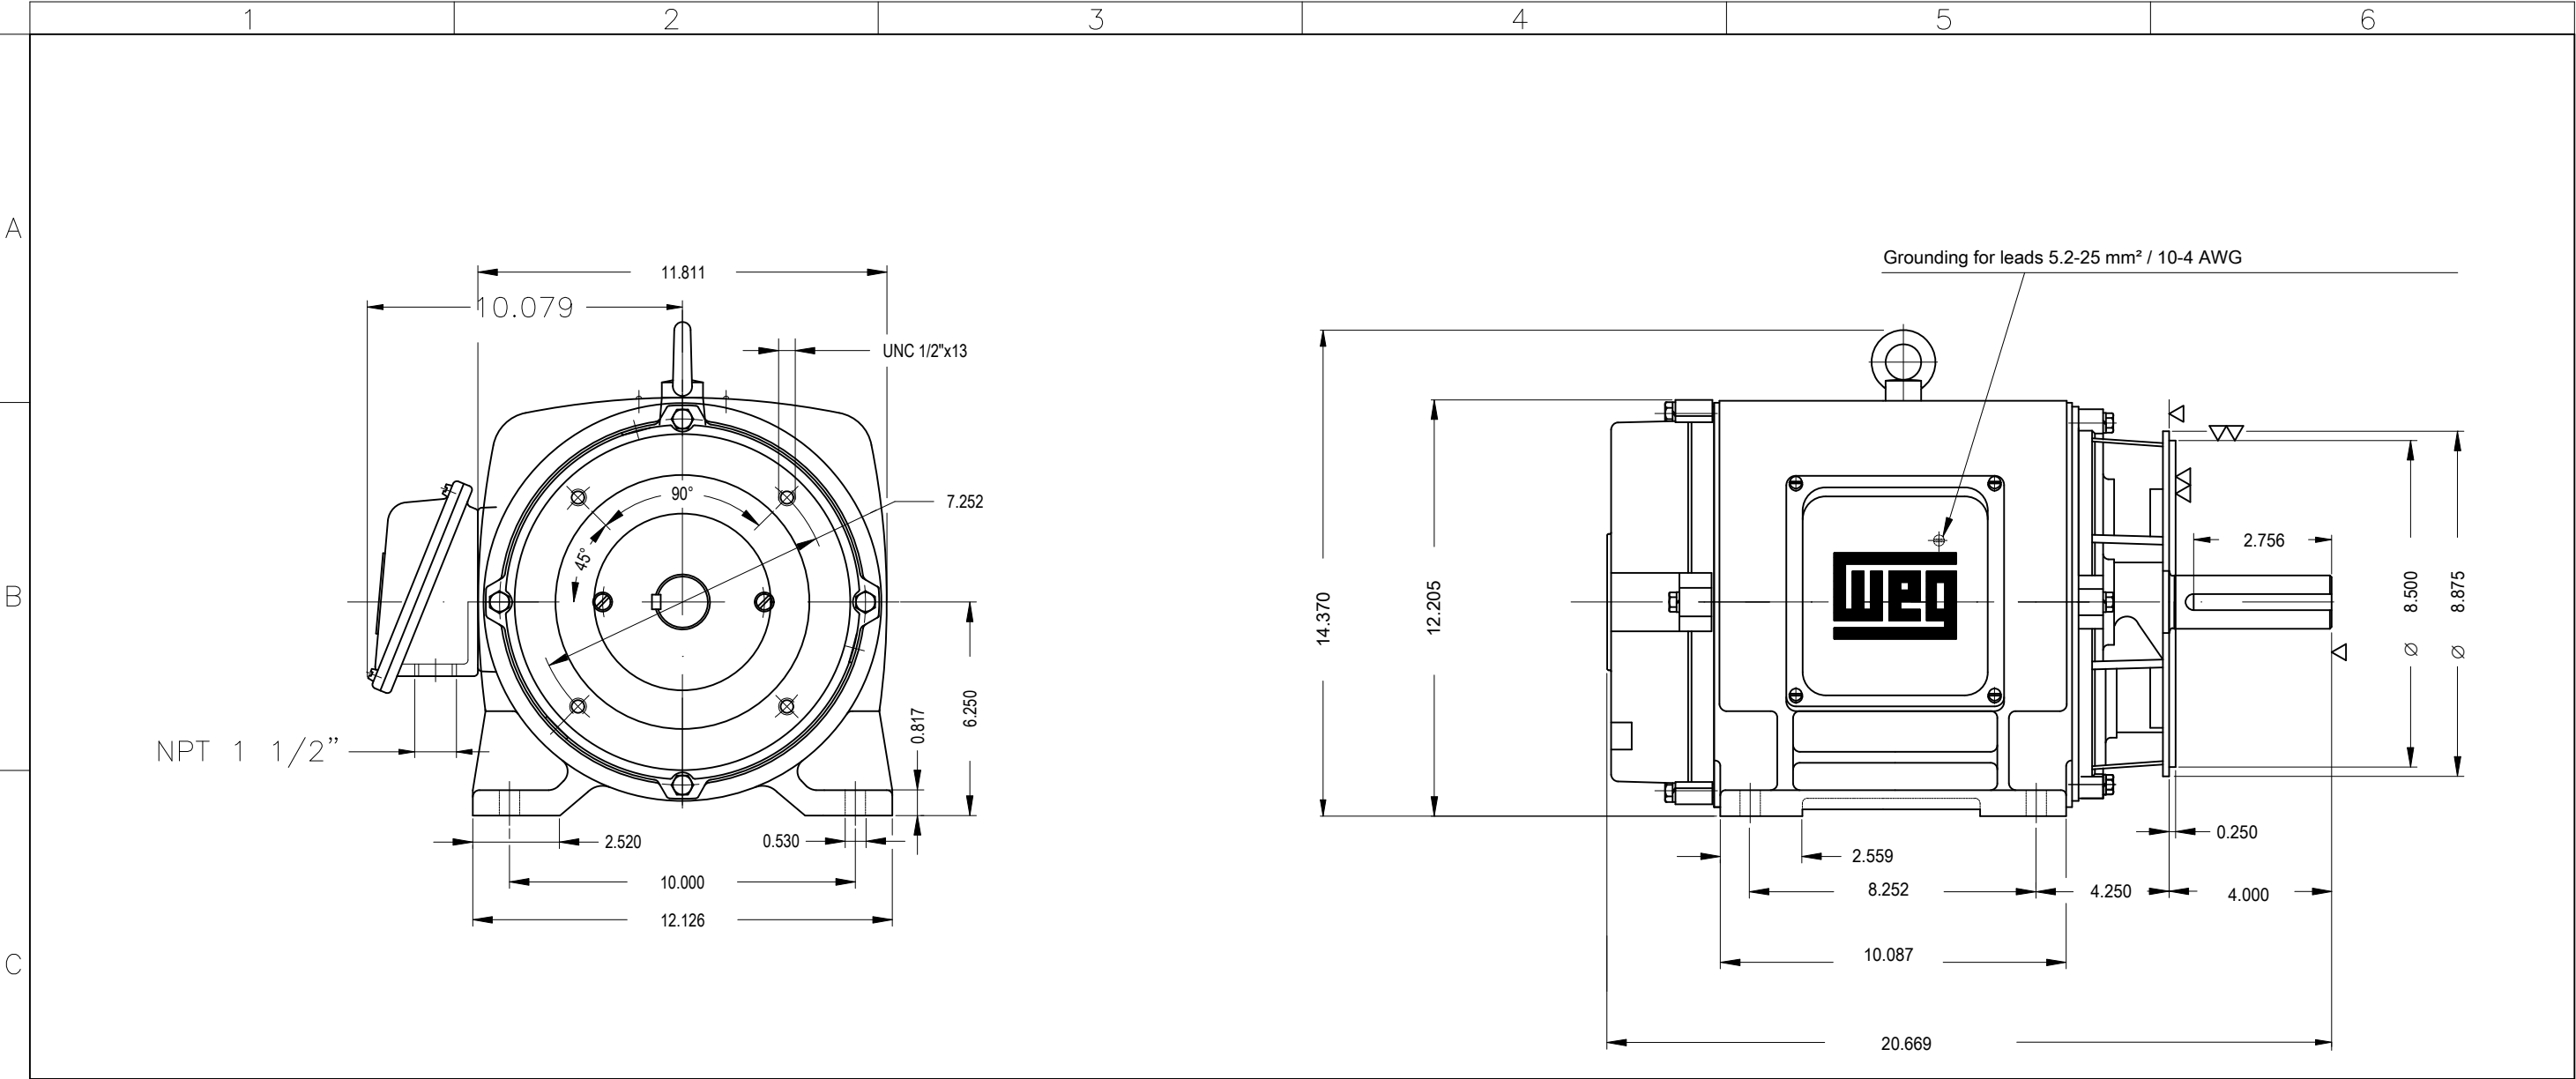

D					20 HP 02 Poles 60 Hz										A	
									HYBRISUSER						00	
					ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER	
					EXECUTED	HYBRISUSER		THREE PH. MOTOR GENERAL HIGH EFF. FRAME 254TC IP23 ODP				PREVIEW				
					CHECKED											
					RELEASED											
					REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET	1 / 1					
											WDD		00			

Certification UL/FIRE PUMP
Color RAL 5009
Painting plan 203A
Mounting NEMA F-1
Mounting B34D

DE Shaft End

