

DATA SHEET

Three Phase Induction Motor - Squirrel Cage



Customer :

Product line : W22 NEMA Premium Efficiency Three-Phase Product code : 11535563

Frame	: 364/5TC	Locked rotor time	: 25s (cold) 14s (hot)
Output	: 75 HP (55 kW)	Temperature rise	: 80 K
Frequency	: 60 Hz	Duty cycle	: Cont.(S1)
Rated voltage	: 575 V	Ambient temperature	: -20°C to +40°C
Poles	: 4	Altitude	: 1000 m.a.s.l.
Rated current	: 69.8 A	Protection degree	: IP55
	: 6.4x(Code G)	Cooling method	: IC411 - TEFC
Rated speed	: 1780 rpm	Mounting	: F-1
Rated torque	: 30.6 kgfm	Rotation ¹	: Both (CW and CCW)
Insulation class	: F	Noise level ²	: 67.0 dB(A)
Service factor	: 1.25	Starting method	: Direct On Line
Moment of inertia (J)	: 0.9798 kgm ²	Approx. weight ³	: 415 kg
Design	: B		

Output	25%	50%	75%	100%	Foundation loads	
Efficiency (%)	0.000	94.5	95.0	95.4	Max. traction	: 685 kgf
Power Factor	0.00	0.68	0.78	0.83	Max. compression	: 1100 kgf

Losses at normative operating points (speed;torque), in percentage of rated output power

P1 (0,9;1,0)	P2 (0,5;1,0)	P3 (0,25;1,0)	P4 (0,9;0,5)	P5 (0,5;0,5)	P6 (0,5;0,25)	P7 (0,25;0,25)
4.7	3.8	3.5	2.4	1.6	1.1	0.7

	Drive end	Non drive end
Bearing type	: 6314 C3	6314 C3
Sealing	: Oil Seal	Oil Seal
Lubrication interval	: 12000 h	12000 h
Lubricant amount	: 27 g	27 g
Lubricant type	Mobil Polyrex EM	

Notes

This revision replaces and cancel the previous one, which must be eliminated.

- (1) Looking the motor from the shaft end.
- (2) Measured at 1m and with tolerance of +3dB(A).
- (3) Approximate weight subject to changes after manufacturing process.
- (4) At 100% of full load.

These are average values based on tests with sinusoidal power supply, subject to the tolerances stipulated in NEMA MG-1.

Rev.	Changes Summary	Performed	Checked	Date
Performed by				
Checked by				
Date	06/05/2026			
		Page 1 / 2		Revision

LOAD PERFORMANCE CURVE


Three Phase Induction Motor - Squirrel Cage



Customer :

Product line : W22 NEMA Premium Efficiency Three-Phase Product code : 11535563

LOAD PERFORMANCE CURVE

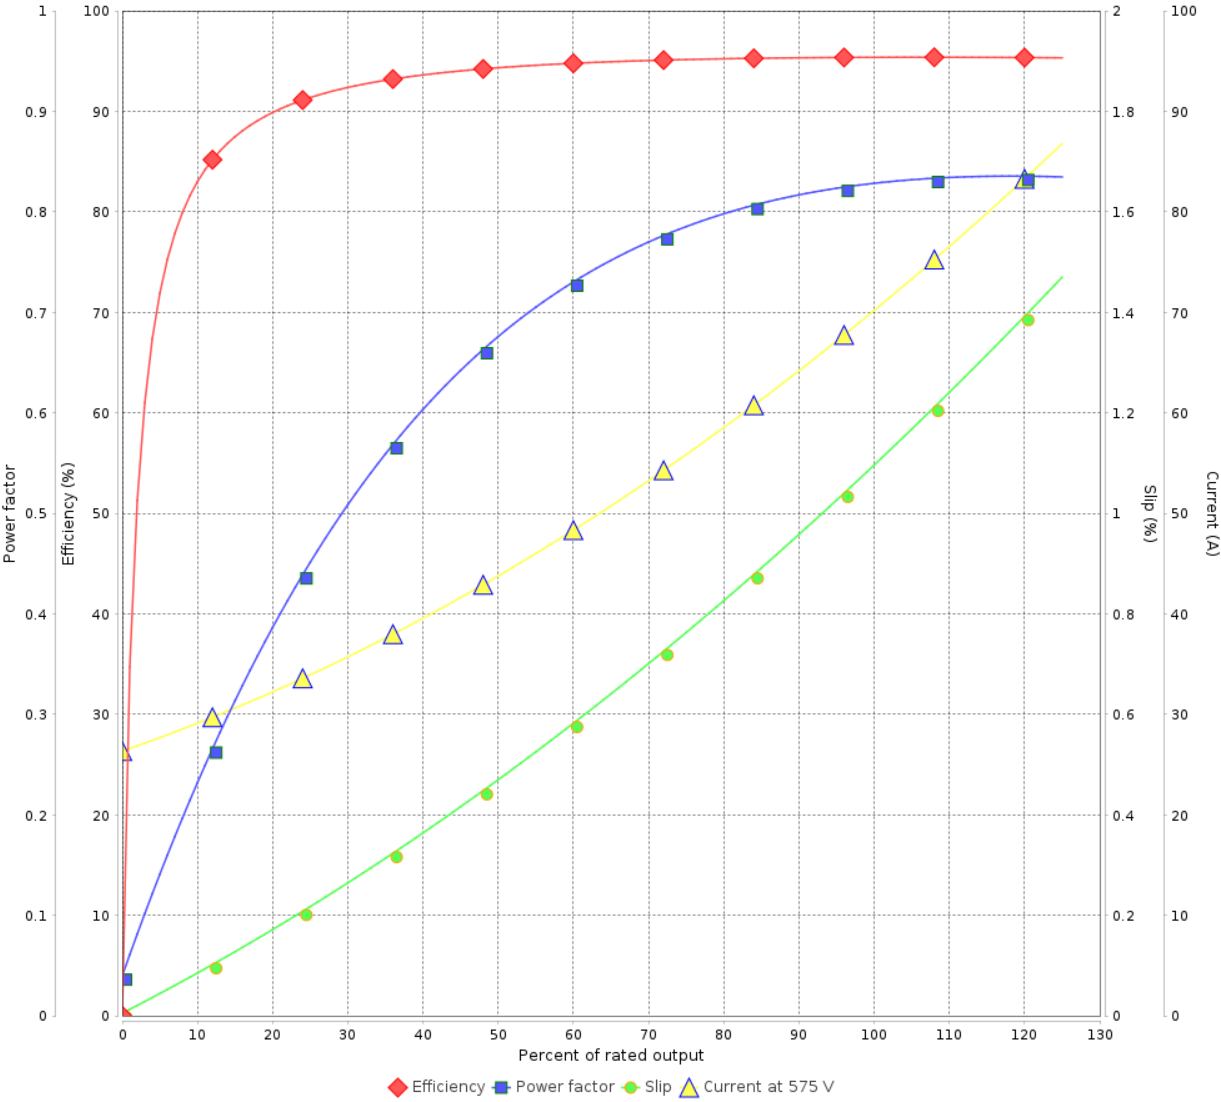

Rev.	Changes Summary		Performed	Checked	Date
Performed by					
Checked by					
Date	06/05/2026				
			Page 2 / 2	Revision	