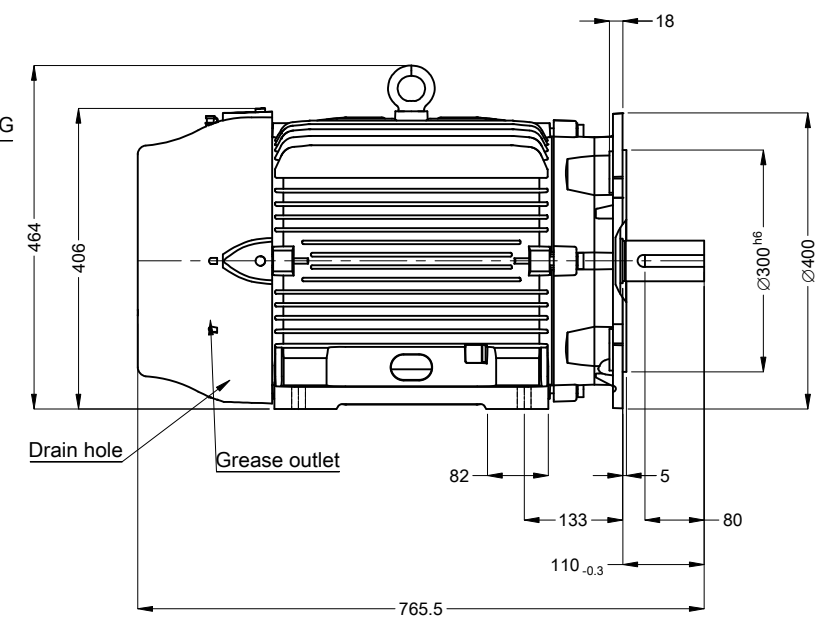
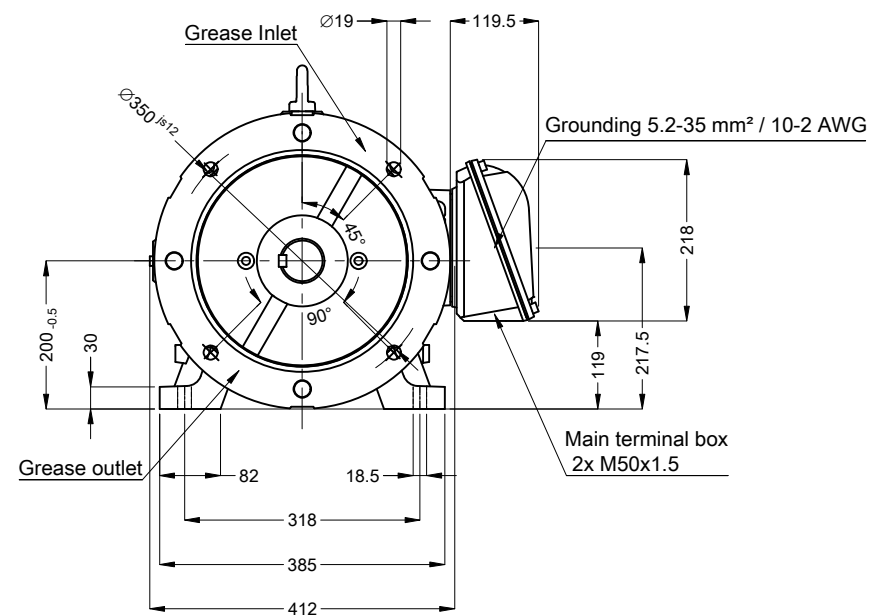
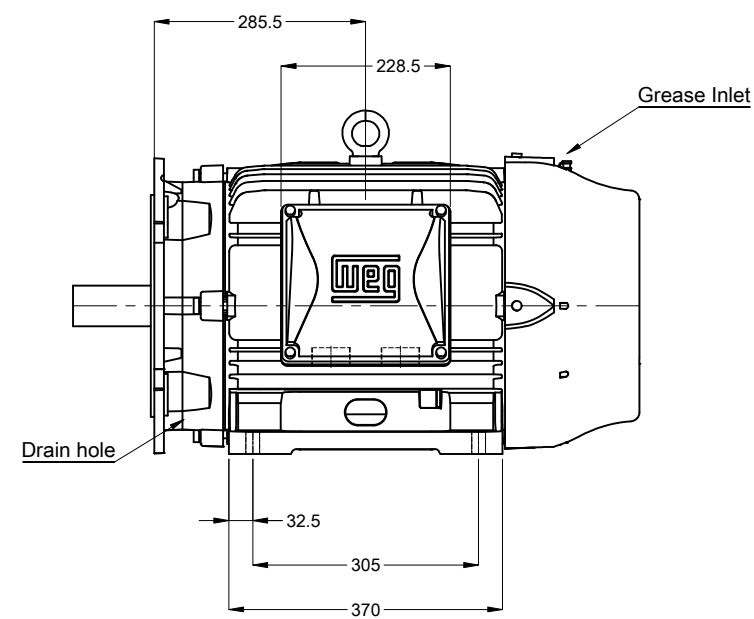


40 HP 04 Poles 60 Hz										A
						Scale 1 : 10				
				HYBRISUSER						00
ECM		LOC		SUMMARY OF MODIFICATIONS				EXECUTED		CHECKED
								RELEASED		DATE
EXECUTED		HYBRISUSER		 THREE PH. MOTOR W22 IE3 FRAME 200L IP55 TEFC				PREVIEW WDD 00		
CHECKED										
RELEASED										
REL. DATE										
						SHEET		1 / 1		