


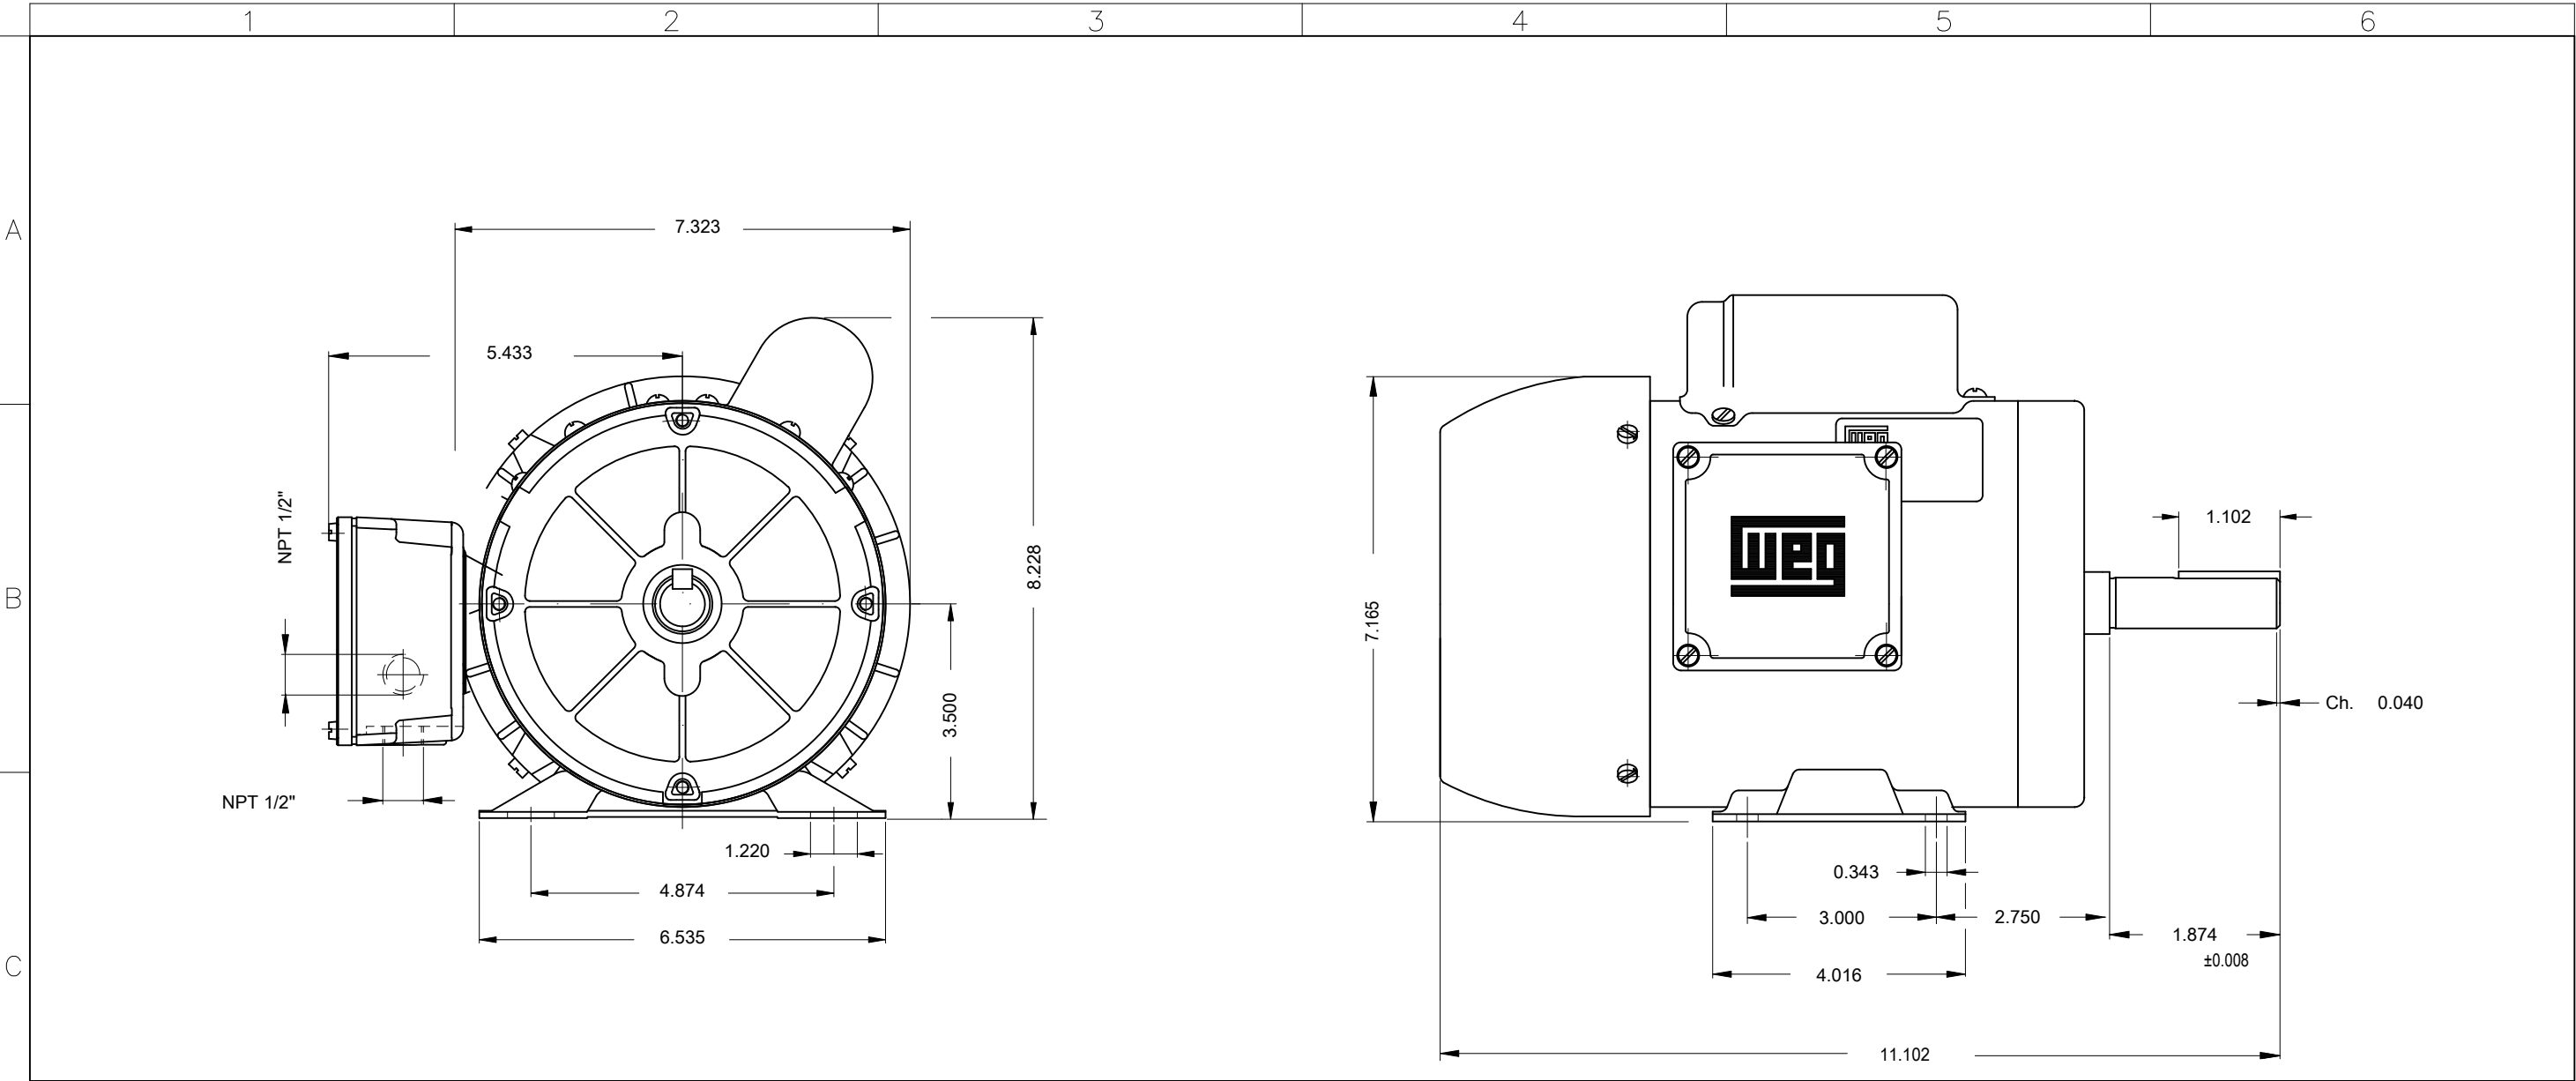

0.1870.1870.62500.62450.517

DE Shaft End0.1870.1870.5170.62500.6245

3/4 HP02 Poles60 Hz

HYBRISUSER

00

ECM	LOC	SUMMARY OF MODIFICATIONS	EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER	SINGLE PH. MOTOR GENERAL FRAME B56 IP55 TEFC					
CHECKED							
RELEASED							
REL. DATE		WMOJaragua do Sul	Product Engineering	SHEET	1 / 1		

PREVIEWWDD00