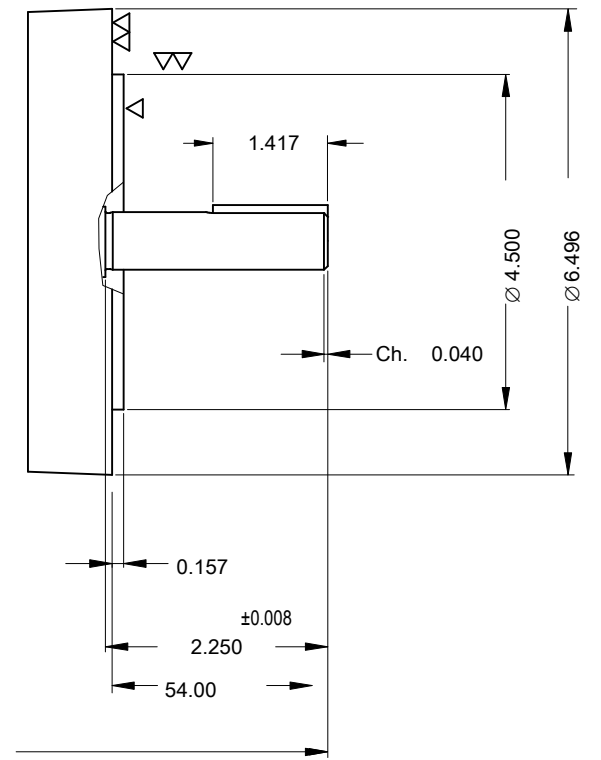
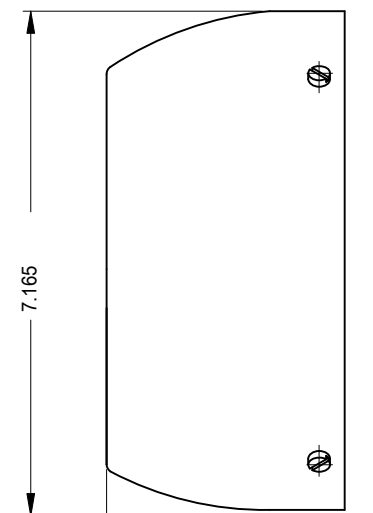
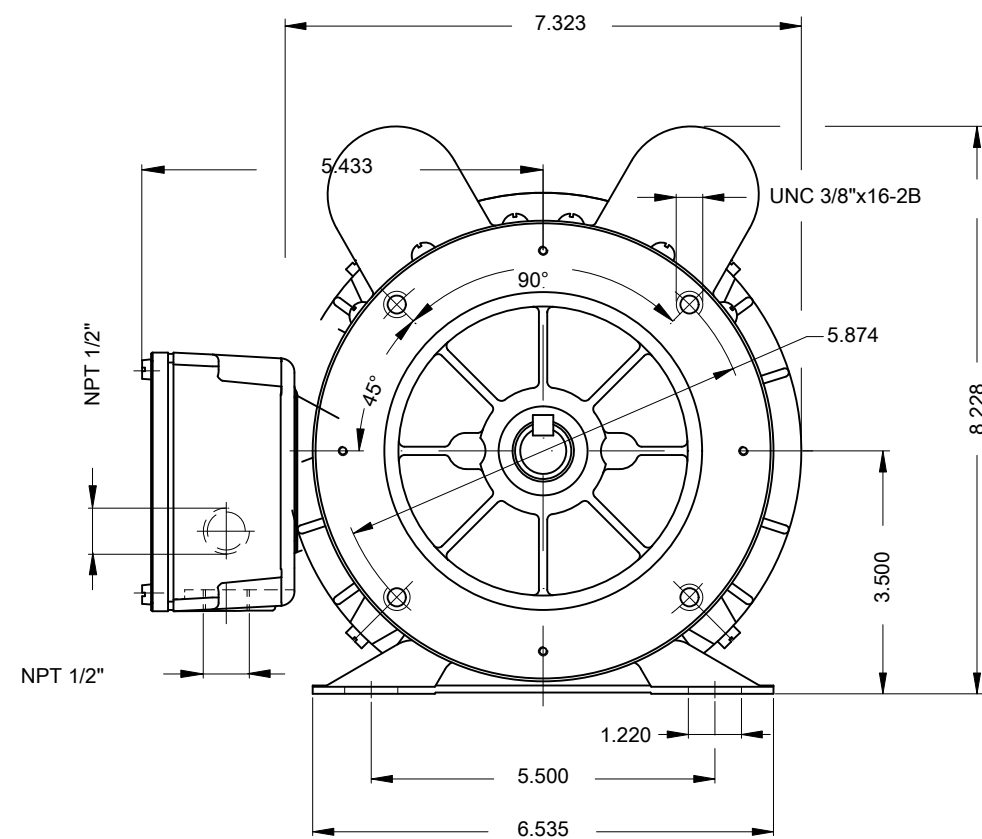



Mounting B34D

1.5 HP 04 Poles 60 Hz										A
							HYBRISUSER			00
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		SINGLE PH. MOTOR GENERAL FRAME G143/5TC IP55 TEFC				PREVIEW WDD 00			
CHECKED										
RELEASED										
REL. DATE		WMO	Jaragua do Sul			Product Engineering	SHEET	1 / 1		