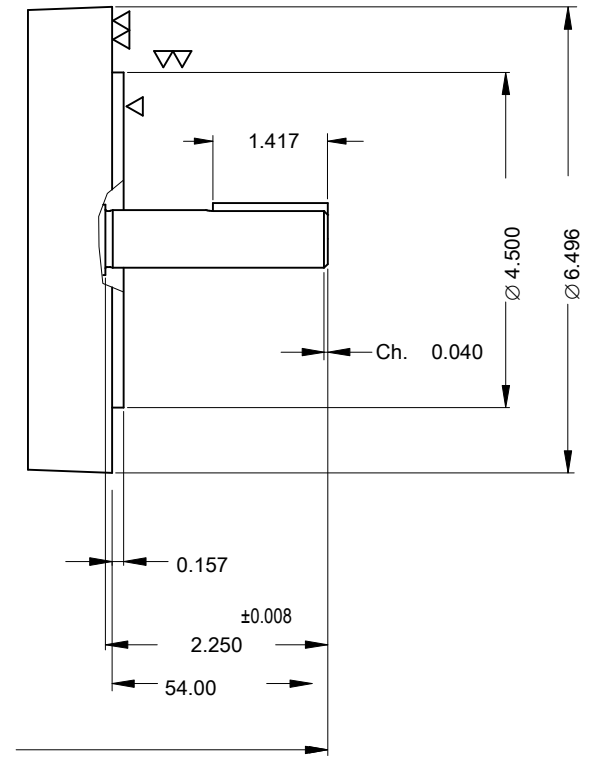
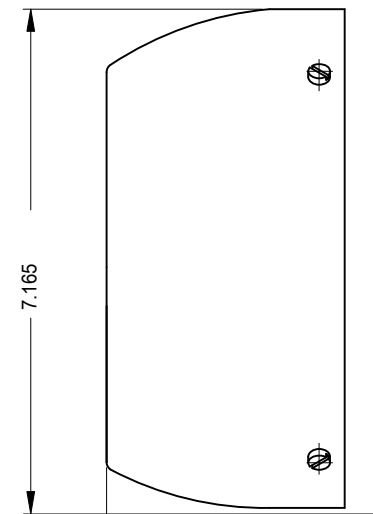
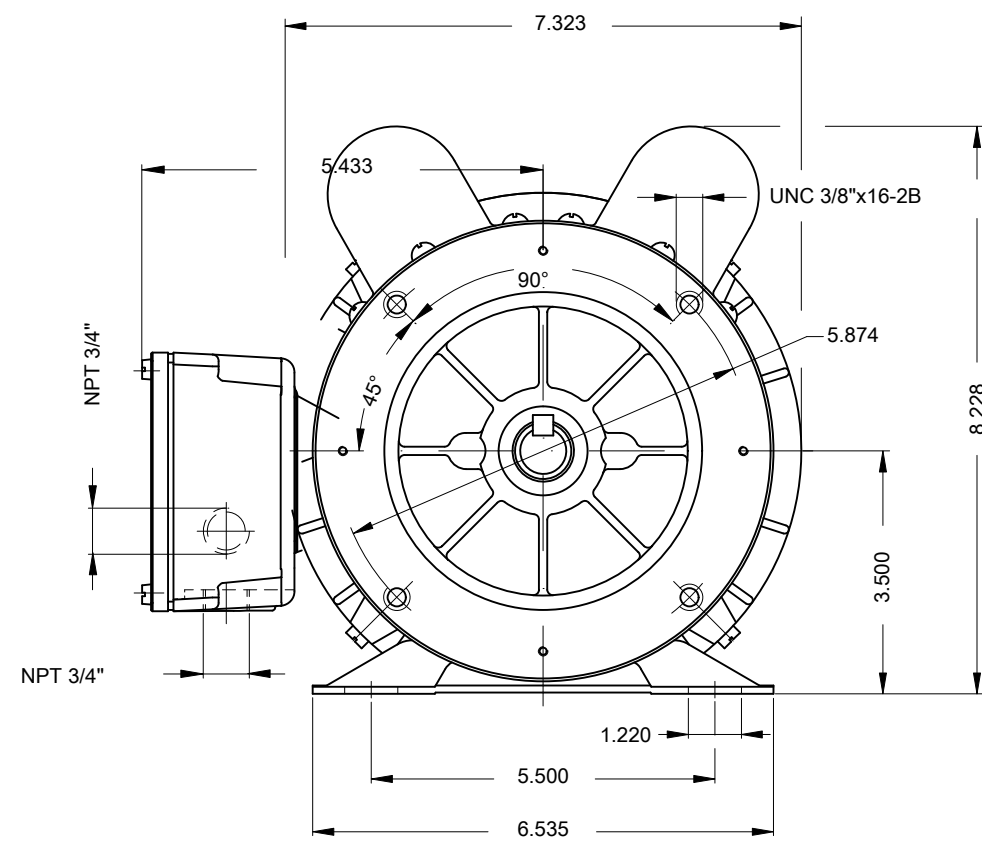


Mounting B34D

2 HP 02 Poles 60 Hz										A
							HYBRISUSER			00
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER	 	SINGLE PH. MOTOR GENERAL FRAME G143/5TC IP55 TEFC				PREVIEW WDD 00			
CHECKED										
RELEASED										
REL. DATE		WMO	Jaragua do Sul		Product Engineering	SHEET	1	/	1	