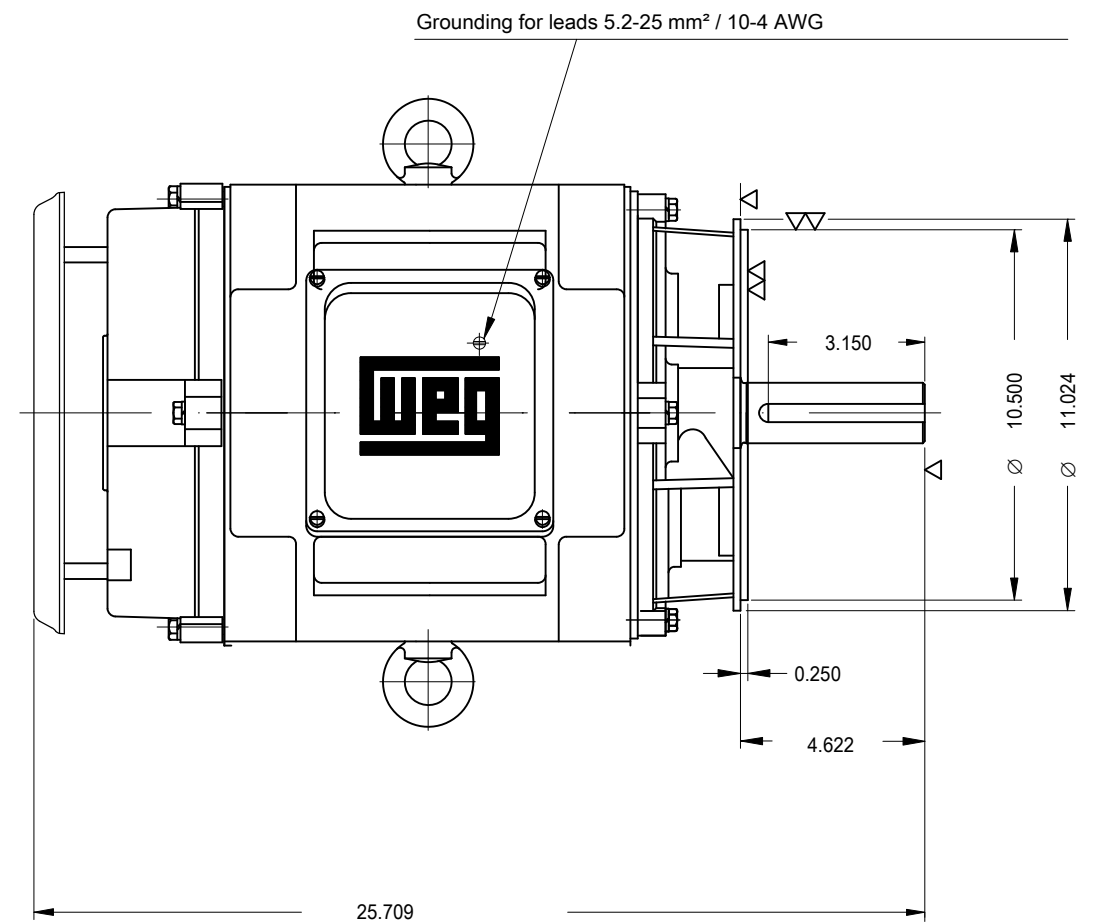
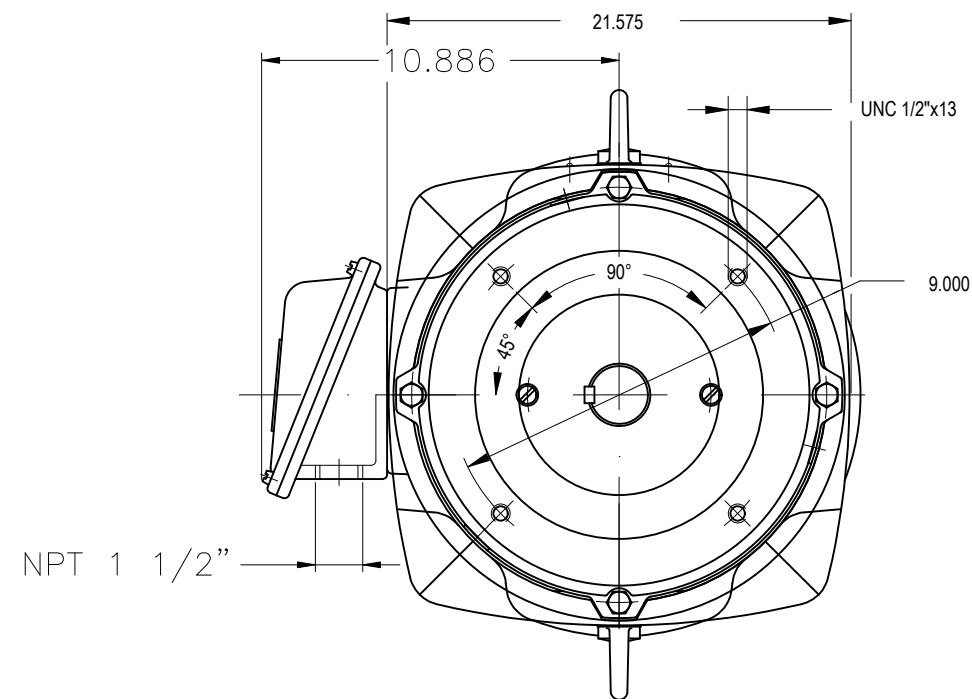



25 HP 04 Poles 60 Hz										A
		DATAVIEWERUSER								00
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	DATAVIEWERUSER		THREE PH. MOTOR GENERAL NEMA PREM. EFF. FRAME 284TC IP23 ODP				PREVIEW WDD 00			
CHECKED										
RELEASED										
REL. DATE		WMO	Jaragua do Sul			Product Engineering		SHEET	1 / 1	