



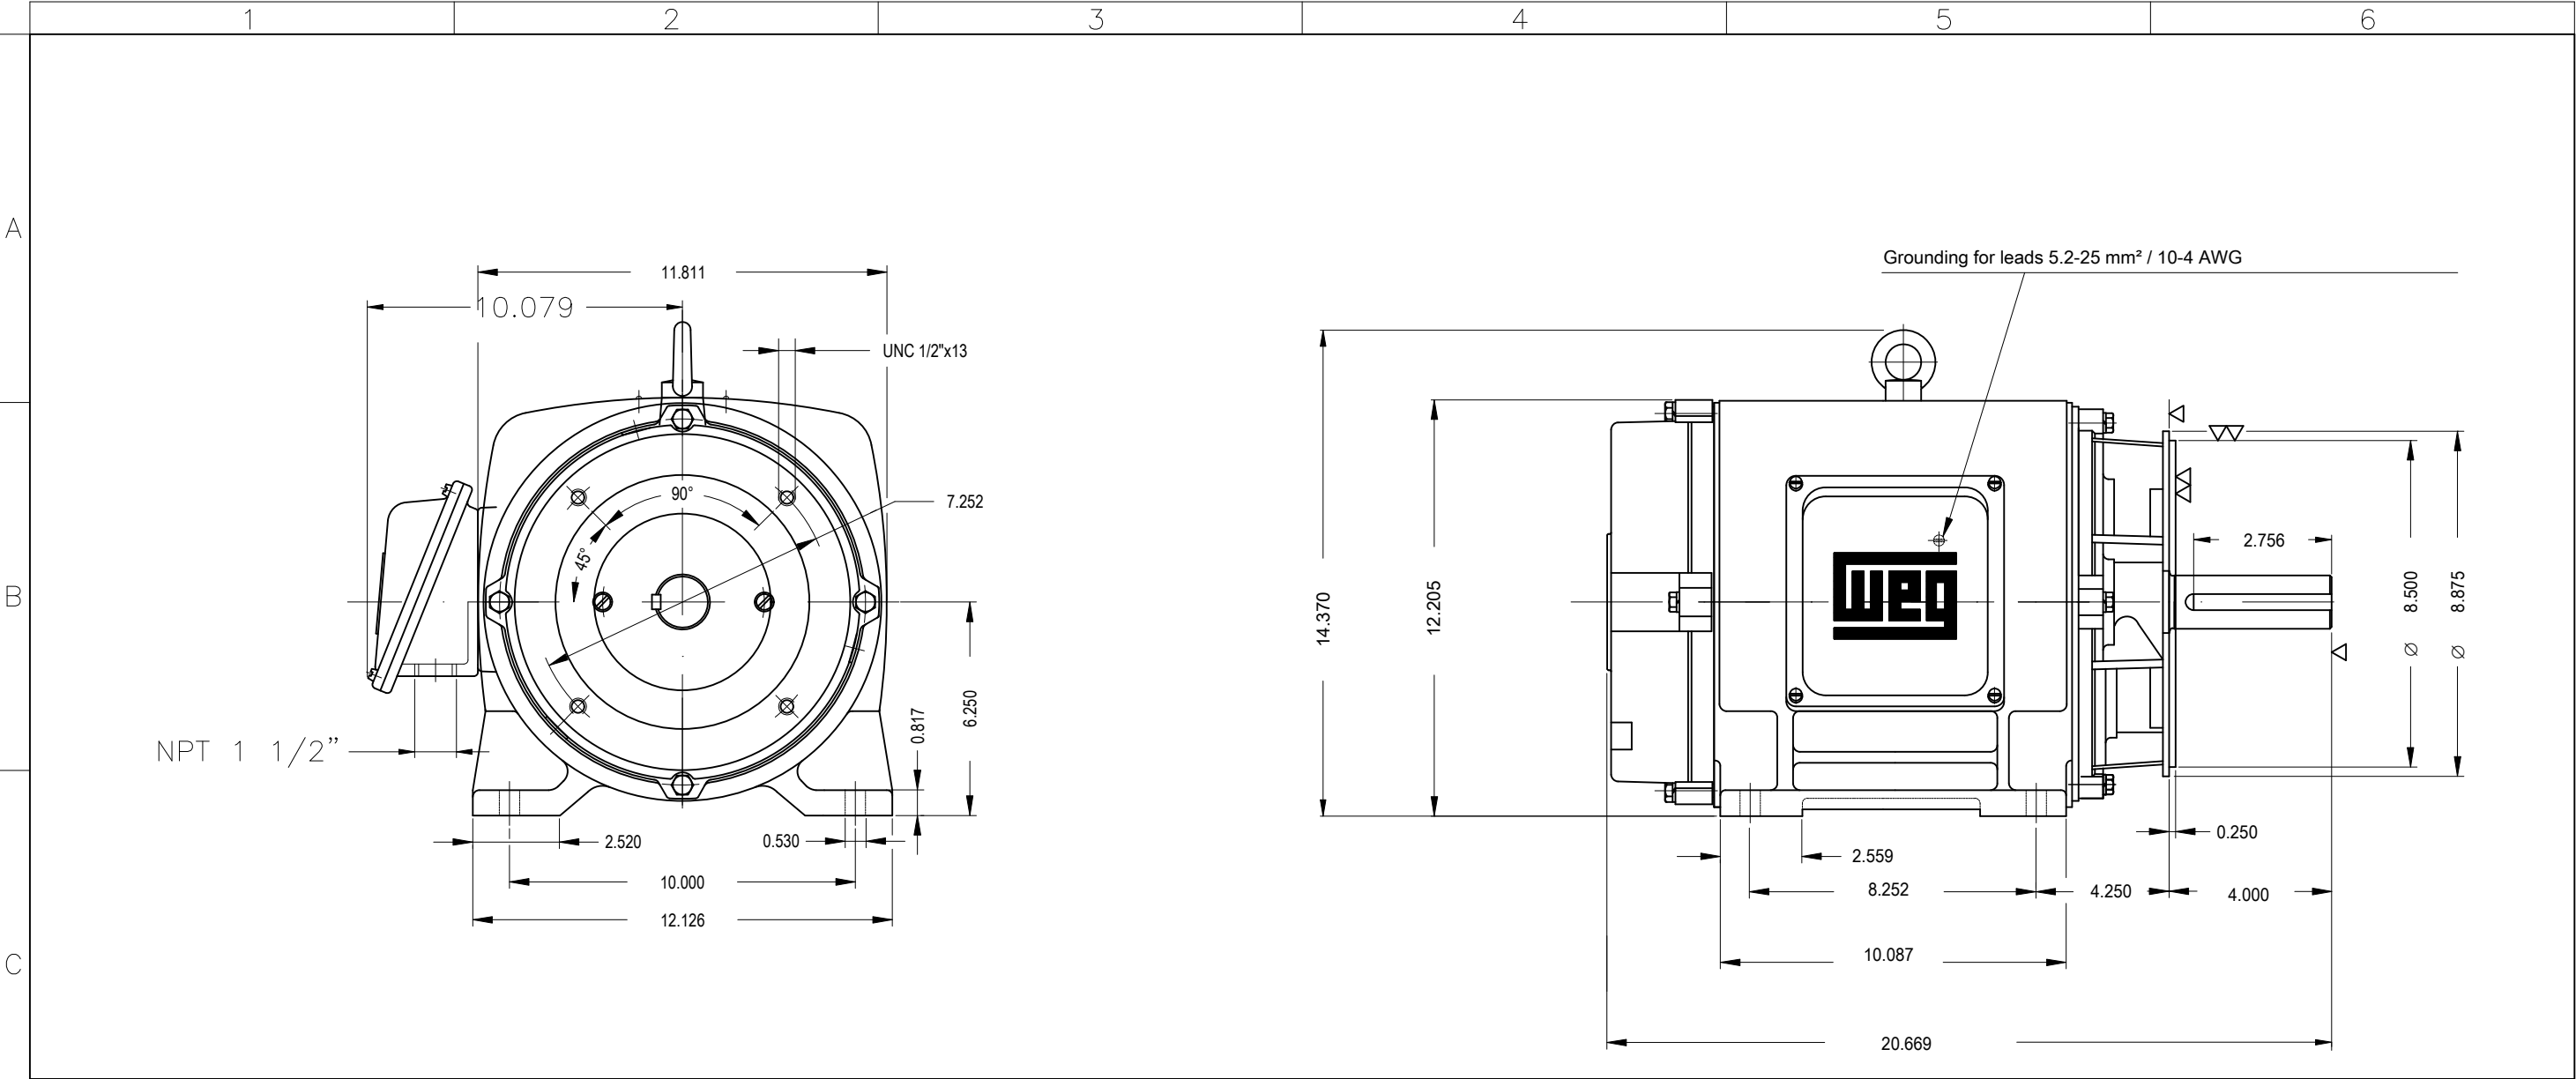

D															20 HP 02 Poles 60 Hz		A					
													HYBRISUSER						00			
					ECM		LOC		SUMMARY OF MODIFICATIONS				EXECUTED		CHECKED		RELEASED		DATE		VER	
					EXECUTED		HYBRISUSER				THREE PH. MOTOR GENERAL HIGH EFF. FRAME 254TC IP23 ODP				PREVIEW WDD 00							
					CHECKED																	
					RELEASED																	
					REL. DATE				WMO		Jaragua do Sul				Product Engineering		SHEET				1 / 1	
Certification UL/FIRE PUMP																						
Color RAL 5009																						
Painting plan 203A																						
Mounting NEMA F-1																						
Mounting B34D																						

DE Shaft End	
0.375	0.375
1.416	
1.6250	
1.6240	

